

Requested by:	CHIMIVER PANSERI S.p.A. Via Bergamo, 1401 24030 PONTIDA (BG)		
For the sample:	Multilayer panel, 50 x 100 x 2,0 cm, marked "1X PRYMAREN + X1 ECOSTAR 2K HD per pavimenti in resina".		
On (date): 09/09/19	Date of receipt in laboratory (sample delivered by the client):		09/10/19
Sampling details - Where: ----- - Date: ----- - How (methods): -----	By whom: CUSTOMER		
Tested in: Bologna	Date of starting: 10/10/19	Date of ending: 10/10/19	

DIN 51130:2004

Determination of the anti-slip properties - Workrooms and fields of activities with raised slip danger, walking method - ramp test

Surface characteristics Smooth Profiled Structured Rough

OPERATIVE CONDITIONS:

Temperature: (23 ± 5) °C
Fixing scheme

See attachment

RESULTS

Average total acceptance angle: **11,8°**
Movement area (cm³/dm²): **Not determinated**

CLASSIFICATION (BGR 181 – 10/2003)


Group of anti-slip properties: **R10**
Movement area evaluation group: **Not determinated**

Pietro Bruzzi
Technical verification



Prof.ssa Maria Chiara Bignozzi
Director

The results reported relate only to the samples tested. No responsibility is taken for the accuracy of the sampling unless it is done under our own supervision. The reproduction of this test report is only authorized in the form of a complete photographic facsimile. Our written approval is necessary for any partial reproduction. This test report consists of 1 page and 1 attachment.

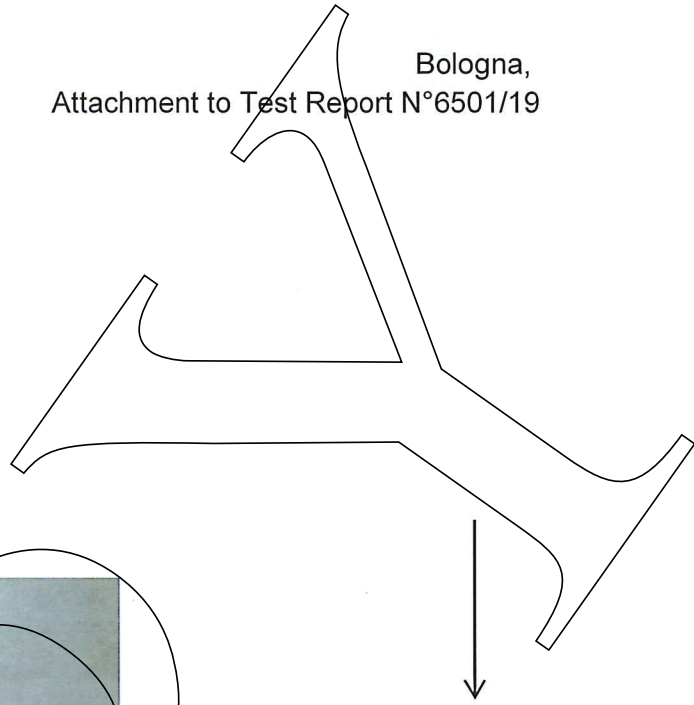

walking
direction

